


PLAN VIEW

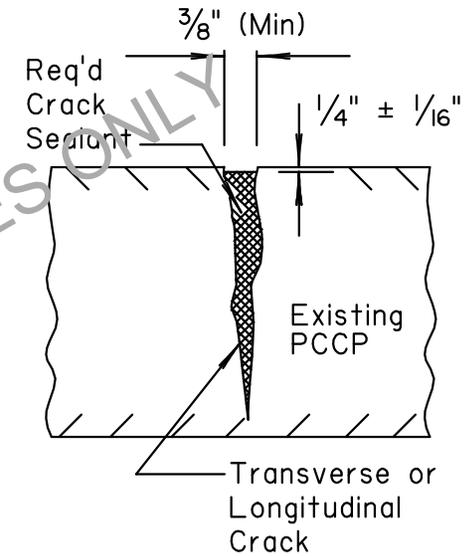

SECTION A-A

NOTES:

1. Applies to random cracks greater than  $\frac{3}{8}$ " in width on jointed pccp.
2. Crack sealing limits shall be as directed by the Project Engineer.
3. Sealant for transverse cracks shall conform to 602.05 of the Standard Specs.
4. Sealant for longitudinal cracks shall be low modulus type I grade A epoxy resin system or silicone.
5. All work on this detail to be paid for under item labeled:  
Cleaning and sealing random cracks.
6. Detail not to scale.

	<b>CLEANING AND SEALING RANDOM CRACKS</b>				DESIGNED CHECKED	BCT MAC	PARISH		SHEET NO.
	CPR-12				DETAILED CHECKED	BCT MAC	CONTROL SECTION		
		NO.	DATE	REVISION DESCRIPTION	BY	DATE SHEET	03-03-11 1 OF 1	STATE PROJECT	