
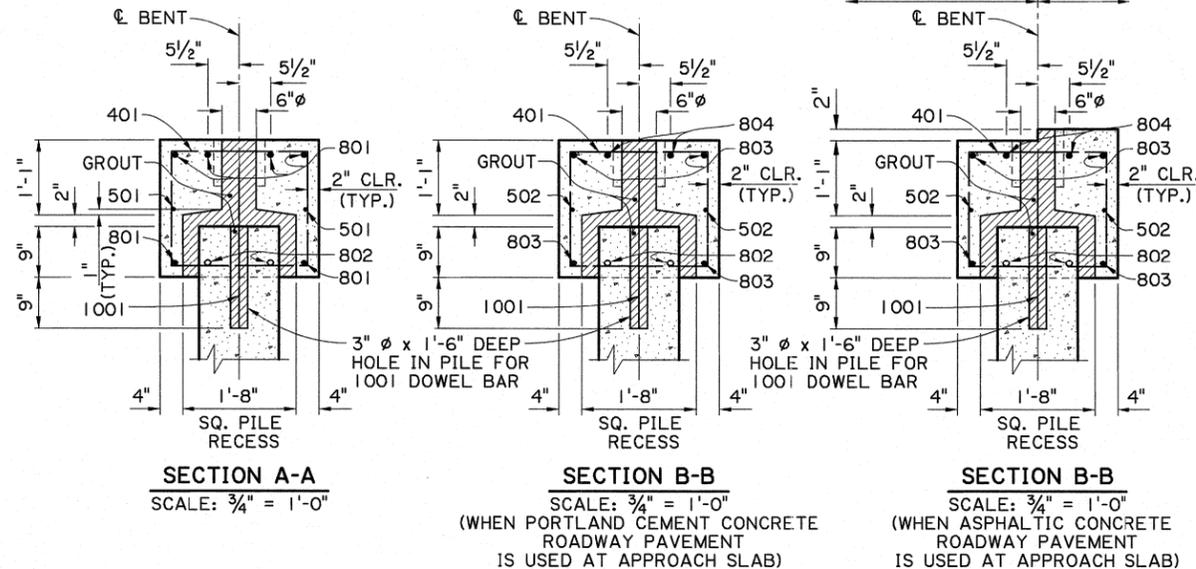


ALTERNATE BENT NOTES:

CONSTRUCTION SPECIFICATIONS: LATEST APPROVED LOUISIANA STANDARD SPECIFICATIONS FOR ROADS AND BRIDGES, SUPPLEMENTAL SPECIFICATIONS AND SPECIAL PROVISIONS.
DESIGN SPECIFICATIONS: AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, 4th EDITION, WITH 2008 & 2009 INTERIMS.
DESIGN LOAD: LIVE LOAD IS HL-93, AND LADV-11 (LOUISIANA DESIGN VEHICLE LIVE LOAD 2011).
STRUCTURAL CONCRETE: ALL CONCRETE SHALL BE CLASS P. STEEL SIDE FORMS AND STEEL OR CONCRETE BOTTOM FORMS SHALL BE USED FOR PRECAST COMPONENTS. EXPOSED EDGES SHALL HAVE A 3/4" CHAMFER UNLESS OTHERWISE NOTED. ALL SURFACES SHALL RECEIVE A CLASS I ORDINARY SURFACE FINISH UPON REMOVAL OF THE FORMS. ALL EXPOSED FACES OF WINGWALLS AND ENDS OF CAPS SHALL RECEIVE A CLASS 2A SPECIAL SURFACE FINISH.
REINFORCING STEEL: ALL REINFORCING SHALL BE GRADE 60. DIMENSIONS RELATING TO FABRICATION ARE OUT TO OUT OF BARS, UNLESS OTHERWISE NOTED. DIMENSIONS RELATING TO SPACING ARE TO BAR CENTERS, UNLESS OTHERWISE NOTED.
GROUT: THE GROUT SHALL BE AN APPROVED FLOWABLE NON-SHRINK GROUT LISTED ON OPL 47. THE GROUT SHALL BE TESTED FOR ACCEPTANCE PRIOR TO USAGE. SURFACES SHALL BE THOROUGHLY SATURATED WITH WATER BY FLOODING THE VOID FOR APPROXIMATELY 5 MINUTES IMMEDIATELY BEFORE THE GROUT IS PLACED. ONLY POTABLE WATER SHALL BE USED FOR SATURATION AND MIXING PURPOSES.
PRECAST UNITS: THE PLANS FOR AN ONGOING OPERATION OF FABRICATING FACILITIES SHALL BE APPROVED BY THE DEPARTMENT. EACH UNIT SHALL HAVE THE FABRICATOR'S MARK AND UNIQUE NUMBER, MEETING THE APPROVAL OF THE ENGINEER, STAMPED OR SCRIBED IN THE PLASTIC CONCRETE. ALL UNITS SHALL BE HELD AT THE PLANT FOR A MINIMUM OF 10 DAYS AFTER CASTING. THE CONCRETE SHALL REACH A MINIMUM STRENGTH OF 3,000 PSI BEFORE HANDLING IS PERMITTED. THE LIFTING INSERTS SHALL BE 1" TYPE S INSERTS AS MANUFACTURED BY DAYTON-SUPERIOR CORPORATION OR AN APPROVED EQUAL. EACH INSERT SHALL HAVE A MINIMUM LOAD CAPACITY OF 10,000 POUNDS. FOUR INSERTS WITH 1" Ø x 5" LONG COIL BOLTS SHALL BE PLACED IN THE TOP OF THE UNITS AND LOCATED AT A DISTANCE 2 1/2 OF ITS LENGTH (+/- 6") FROM EACH END AND 6" FROM THE EDGES. INSERT HOLES SHALL BE GROUT FILLED AFTER PLACEMENT OF THE UNIT. AT THE CONTRACTOR'S OPTION, A SLING OF SUFFICIENT CAPACITY MAY BE USED FOR LIFTING, PROVIDED THE SAME PICKUP LOCATIONS FROM THE ENDS ARE USED.
PRECAST CONCRETE PILES: PILES SHALL BE FABRICATED ACCORDING TO STANDARD DETAIL C.S. 216. THE CENTROID OF THE PILE AT CUTOFF ELEVATION SHALL NOT VARY FROM THE PLAN LOCATION BY MORE THAN 3" MEASURED EITHER PERPENDICULAR OR PARALLEL TO THE CENTERLINE OF BENT. IF THE CENTROID OF A PILE IS OUTSIDE THESE LIMITS BUT WITHIN THE ACCURACY OF DRIVING REQUIRED BY THE SPECIFICATIONS, A BENT CAP SHALL BE PROVIDED ACCORDING TO THE CAST-IN-PLACE ALTERNATE. EXTERIOR PILES ARE TO BE BATTERED OUTWARD A 1 1/2 ON 12 IN THE LONGITUDINAL DIRECTION OF THE BENT, WHEN NOTED ON THE GENERAL PLAN.
BASIS OF PAYMENT: ALL MATERIALS SHALL BE PAID FOR UNDER "BRIDGE SUPERSTRUCTURE AND SUBSTRUCTURE" ACCORDING TO THE SPECIFICATIONS.

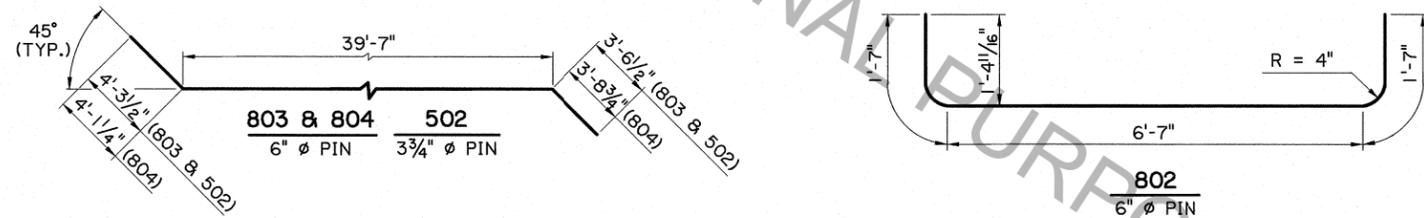

ESTIMATED QUANTITIES (ONE INTER. BENT)				
BAR NO.	UNIT	LENGTH	TOTAL LENGTH	LOCATION
1001	5	2'-4"	11'-8"	DOWELS IN PILES
TOTAL NO. 10 BARS = 11'-8" = 50 LBS.				
801	6	45'-8"	274'-0"	LONGIT. IN CAP
802	8	9'-9"	78'-0"	LONGIT. IN CAP BTW. PILES
TOTAL NO. 8 BARS = 352'-0" = 940 LBS.				
501	2	45'-8"	91'-4"	LONGIT. IN CAP
TOTAL NO. 5 BARS = 91'-4" = 95 LBS.				
401	52	8'-2"	424'-8"	STIRRUPS IN CAP
403	8	6'-6"	52'-0"	STIRRUPS IN CAP
TOTAL NO. 4 BARS = 476'-8" = 318 LBS.				
TOTAL DEFORMED REINFORCING STEEL = 1403 LBS.				
TOTAL CLASS P CONCRETE = 7.39 CU. YDS.				
MAX. PILE LOAD: SERVICE DEAD LOAD = 22 TONS				
SERVICE LIVE LOAD = 33 TONS				
FACTORED TOTAL LOAD = 76 TONS				
TOTAL GROUT FOR PILE RECESSES = 0.36 CU. YDS.				

ESTIMATED QUANTITIES (ONE END BENT)				
BAR NO.	UNIT	LENGTH	TOTAL LENGTH	LOCATION
1001	5	2'-4"	11'-8"	DOWELS IN PILES
TOTAL NO. 10 BARS = 11'-8" = 50 LBS.				
802	8	9'-9"	78'-0"	LONGIT. IN CAP BTW. PILES
803	4	47'-5"	189'-8"	LONGIT. IN CAP
804	2	47'-5"	94'-10"	LONGIT. IN CAP
TOTAL NO. 8 BARS = 362'-6" = 968 LBS.				
502	2	47'-7"	94'-10"	LONGIT. IN CAP
TOTAL NO. 5 BARS = 94'-10" = 99 LBS.				
401	48	8'-2"	392'-0"	STIRRUPS IN CAP
402	8	9'-10"	78'-8"	STIRRUPS IN WINGWALL
403	8	6'-6"	52'-0"	STIRRUPS IN CAP
404	8	2'-2"	17'-4"	LONGIT. IN WINGWALL
TOTAL NO. 4 BARS = 540'-0" = 361 LBS.				
TOTAL DEFORMED REINFORCING STEEL = 1,478 LBS.				
TOTAL CLASS P CONCRETE = 8.05 CU. YDS.				
MAX. PILE LOAD: SERVICE DEAD LOAD = 22 TONS				
SERVICE LIVE LOAD = 33 TONS				
FACTORED TOTAL LOAD = 76 TONS				
TOTAL GROUT FOR PILE RECESSES = 0.36 CU. YDS.				

ADD 0.31 CU. YDS. OF CLASS P CONCRETE PER BENT WHEN ASPHALTIC CONCRETE ROADWAY PAVEMENT IS USED AT APPROACH SLAB.

AS-DESIGNED RATING		
VEHICLE	RATING FACTOR	NOTES
HL-93 (INV)	3.101	---
HL-93 (OPR)	4.020	---
LADV-11 (INV)	2.386	MAGNIFICATION FACTOR = 1.3



SHEET NUMBER

DESIGNED BY: B. DELATTE
 CHECKED BY: J. NAKHLEH
 DETAILED BY: D. NYMEL
 CHECKED BY: J. NAKHLEH

PARISH: LA
 CONTROL SECTION: LA
 STATE: LA
 PROJECT: 12/14/2010
 NUMBER: 6 OF 13

NO. DATE

REVISION OR CHANGE ORDER DESCRIPTION

BY

ALTERNATE BENTS (2 OF 2)
 PRECAST CONCRETE BENTS
 28'-0" CLEAR ROADWAY
 45° CROSSING TWO WAY TANGENT

STANDARD DETAIL
 PSS-45-28-20SL

DOTD
 TRANSPORTATION
 DEPARTMENT